


ARCHITECT NOTE:


1/2" MINIMUM DEFLECTION SPACE AT EACH FLOOR ACCOMMODATES 1/4" DISPLACEMENT. WIDER MOVEMENT JOINTS MAY BE REQUIRED BASED UPON ANTICIPATED MOVEMENTS OF STRUCTURAL ELEMENTS AND THE SEALANT PROPERTIES.

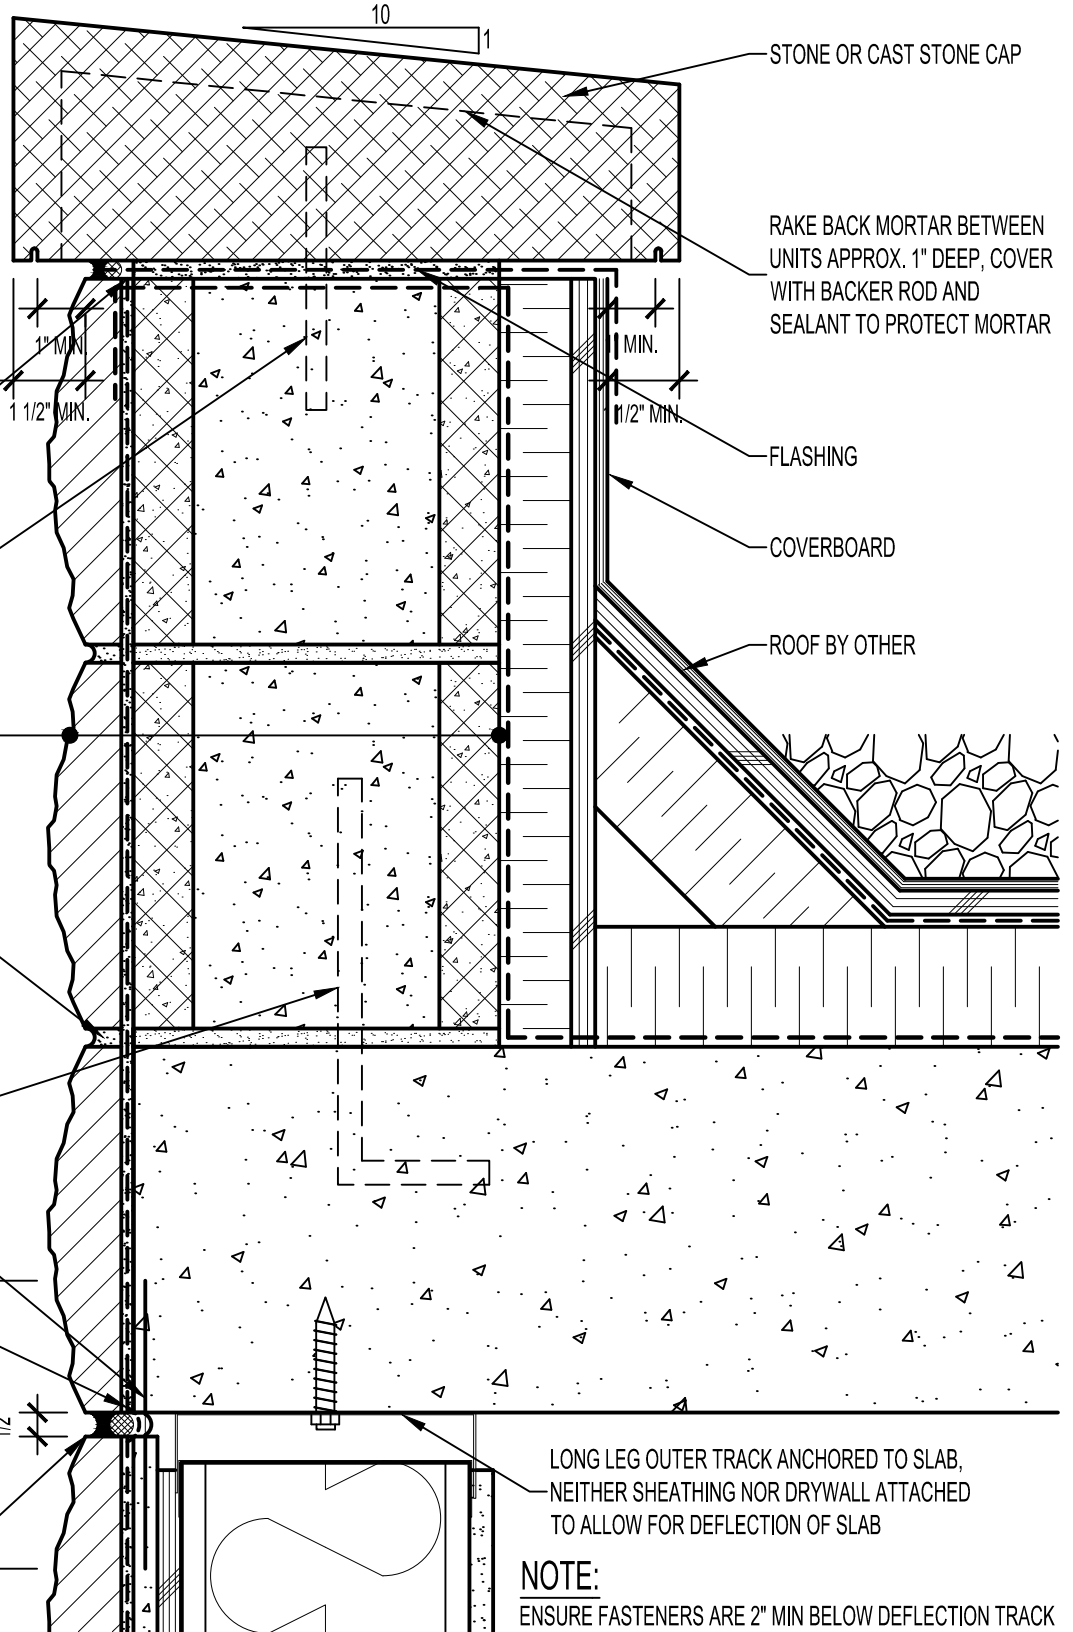

SEALANT AND BACKER ROD
 MECHANICAL ANCHOR
 CALCIUM SILICATE TILE UNIT, HI-BOND MASONRY VENEER
 MORTAR - POLYMER FORTIFIED, LATICRETE AIR & WATER BARRIER, CONCRETE MASONRY UNIT (CMU)
 POINTING MORTAR
 VERTICAL REINFORCING IF REQUIRED
 WATERPROOFING FABRIC LEFT LOOSE FOR ACCOMMODATION OF SLAB EDGE MOVEMENT
 COAT WATERPROOFING FABRIC WITH AIR / WATER BARRIER
 MOVEMENT JOINT REFERENCE NOTE IN TOP LEFT CORNER
 MOVEMENT JOINT SEALED WITH SILICONE SEALANT AND BACKER ROD

STONE OR CAST STONE CAP
 RAKE BACK MORTAR BETWEEN UNITS APPROX. 1" DEEP, COVER WITH BACKER ROD AND SEALANT TO PROTECT MORTAR
 FLASHING
 COVERBOARD
 ROOF BY OTHER

NOTE:
 ENSURE FASTENERS ARE 2" MIN BELOW DEFLECTION TRACK

			ARRISCRAFT-CADD		DETAIL No: SS08RAT
DATE DRAWN: 03/02/15			SCALE: 3"=1'-0"		DRAWN BY: TRI
			TITLE: PARAPET TO WALL WITH STONE OR CAST STONE CAP		U122