


ARCHITECT NOTE:

- DETAIL FOR SUPPORTED PROGUARD DP® - DOUBLE DRAINAGE PLANE PANELS.

- ENGINEER OF RECORD TO SELECT PROGUARD DP® SCREW SPACING USING NTA REPORT TRIG030116-28.
- 1/2" MINIMUM DEFLECTION SPACE AT EACH FLOOR ACCOMMODATES 1/4" DISPLACEMENT. WIDER MOVEMENT JOINTS MAY BE REQUIRED BASED UPON ANTICIPATED MOVEMENTS OF STRUCTURAL ELEMENTS AND THE SEALANT PROPERTIES.
- ENSURE FASTENERS ARE 2" BELOW DEFLECTION TRACK.

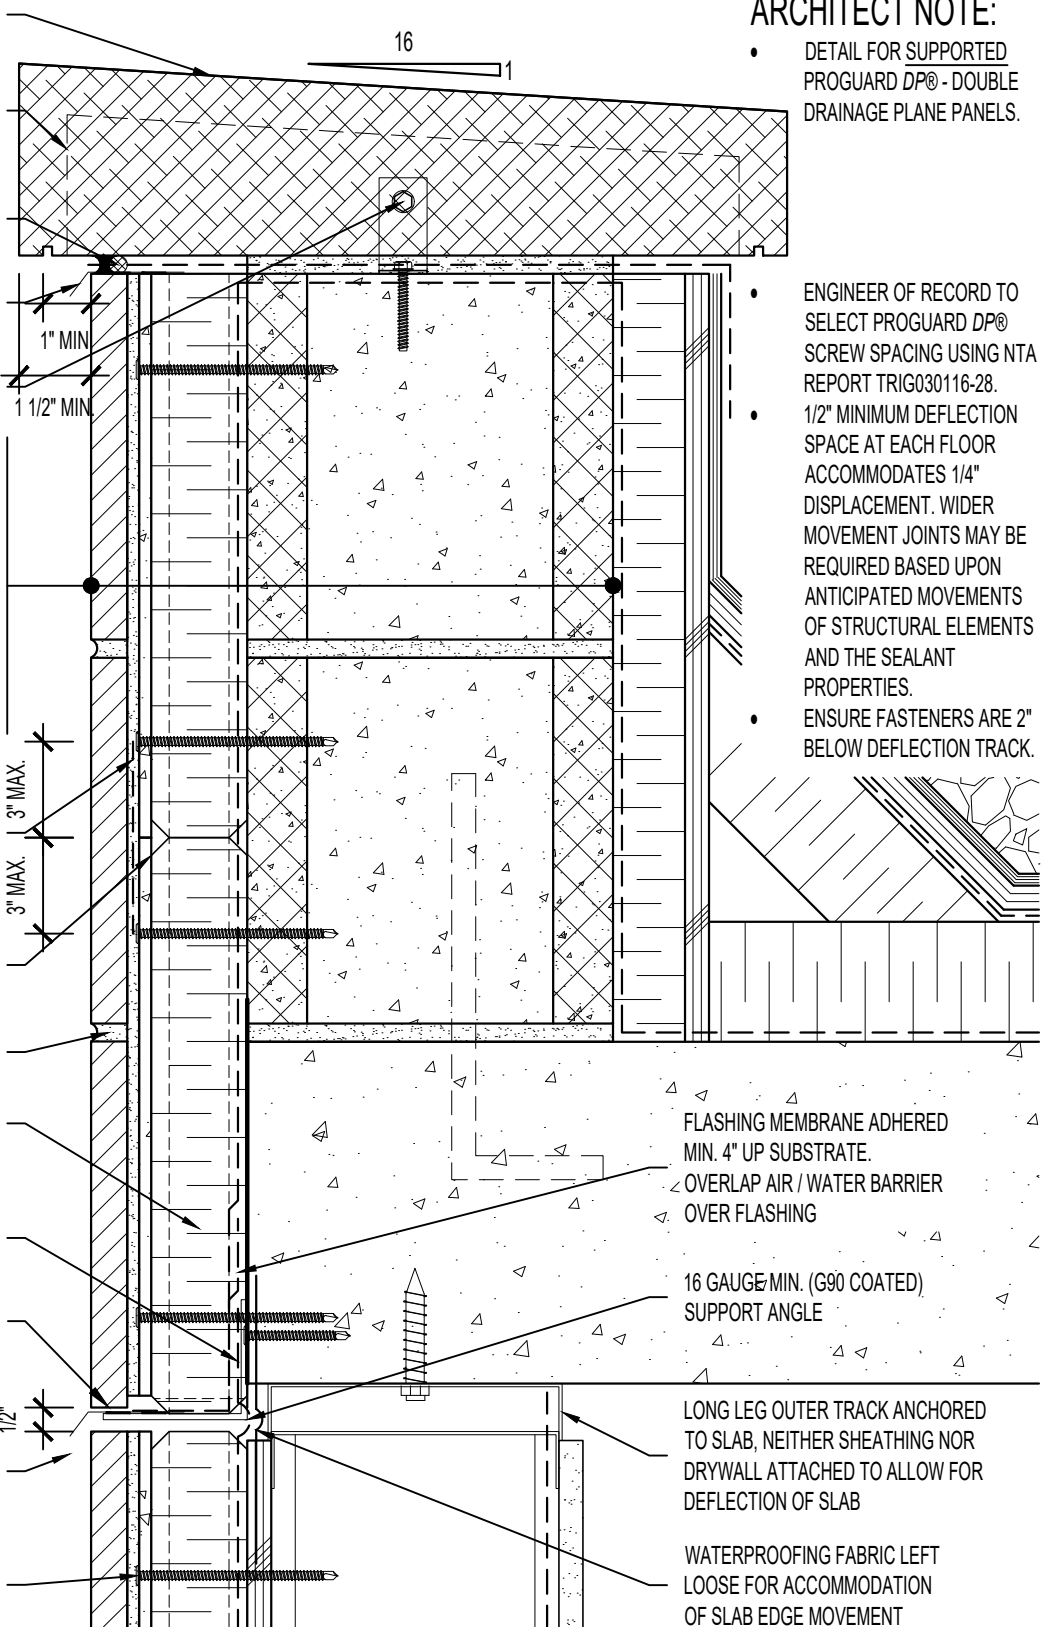

SINGLE SLOPED CAST STONE CAP

RAKE BACK MORTAR BETWEEN UNITS
APPROX. 1" DEEP. COVER WITH
BACKER ROD AND SEALANT TO
PROTECT MORTAR

COMPRESSIBLE BACKER ROD
AND SILICONE SEALANT

FLASHING MEMBRANE SET ON
PREBRENT METAL DRIP EDGE

BENT STRAP ANCHOR IN HEAD JOINT.
SEAL AROUND FLASHING

THIN-CLAD CALCIUM SILICATE TILE,
MVIS™ HI-BOND VENEER MORTAR -
POLYMER FORTIFIED,
PROGUARD DP® INSULATED CONCRETE
BOARD PANEL - DOUBLE DRAINAGE
PLANE (THICKNESS DEPENDENT ON
REQUIRED R-VALUE),
MVIS™ AIR & WATER BARRIER or
WATERARMOR® AWB,
CONCRETE MASONRY UNIT (CMU)

TAPE JOINT WITH ALKALI-RESISTANT
MESH TAPE AND MUD JOINT WITH
MVIS™ HI-BOND VENEER MORTAR

INSULATION CHAMFERED AT TOP
AND BOTTOM OF PANEL EDGES TO
ALLOW FOR CONTINUOUS DRAINAGE

MVIS™ POINTING MORTAR

1'-0" x 8'-0" PROGUARD DP® BASE
WEEP PANEL - DOUBLE DRAINAGE
PLANE AT ALL FLASHING LOCATIONS

COAT WATERPROOFING FABRIC
WITH AIR / WATER BARRIER

LEAVE 1/8" GAP BETWEEN
BOTTOM OF UNIT AND FLASHING

PREFINISHED METAL DRIP EDGE
SET ON TWO BEADS OF
URETHANE SEALANT

ATTACH PROGUARD DP® PANELS
WITH SILVER C APPROVED SCREWS
THROUGH TO STUDS (TYPICAL)

FLASHING MEMBRANE ADHERED
MIN. 4" UP SUBSTRATE.

OVERLAP AIR / WATER BARRIER
OVER FLASHING

16 GAUGE MIN. (G90 COATED)
SUPPORT ANGLE

LONG LEG OUTER TRACK ANCHORED
TO SLAB, NEITHER SHEATHING NOR
DRYWALL ATTACHED TO ALLOW FOR
DEFLECTION OF SLAB

WATERPROOFING FABRIC LEFT
LOOSE FOR ACCOMMODATION
OF SLAB EDGE MOVEMENT



ARRISCRAFT-CADD

DETAIL No:
SS08SAT - DP2S

TITLE:
PARAPET TO WALL WITH
STONE OR CAST STONE CAP

U122

DATE DRAWN: 16 Jan 2021
SCALE: 3"=1'-0"
DRAWN BY: TRI