



**ARCHITECT NOTE:**

1/2" MINIMUM DEFLECTION SPACE AT EACH FLOOR ACCOMMODATES 1/4" DISPLACEMENT. WIDER MOVEMENT JOINTS MAY BE REQUIRED BASED UPON ANTICIPATED MOVEMENTS OF STRUCTURAL ELEMENTS AND THE SEALANT PROPERTIES.

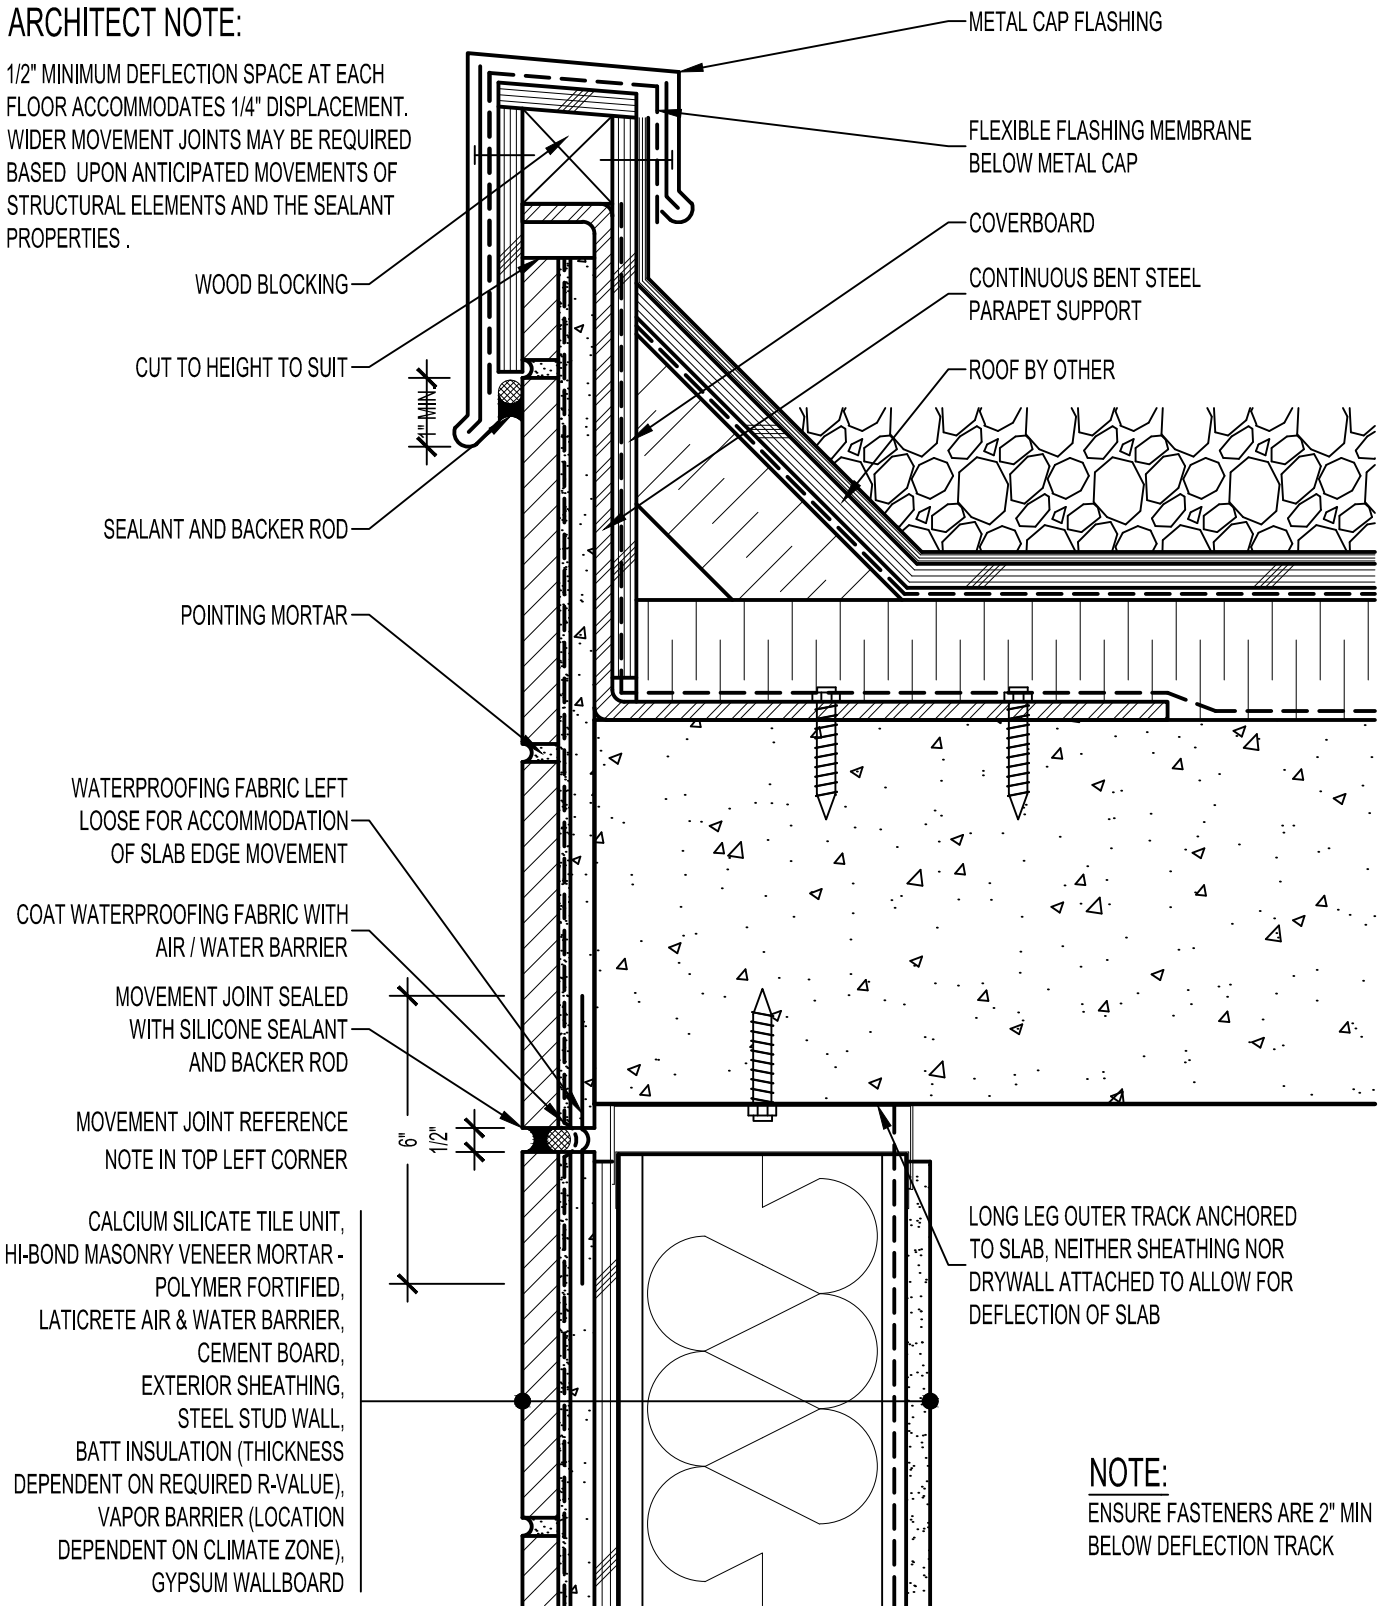

**NOTE:**  
ENSURE FASTENERS ARE 2" MIN BELOW DEFLECTION TRACK

			<b>ARRISCRAFT-CADD</b>		DETAIL No: SS08SAT
DATE DRAWN: 03/02/15			SCALE: 3"=1'-0"		DRAWN BY: TRI
			TITLE: LOW PARAPET TO WALL WITH METAL CAP FLASHING		<b>U120</b>