


**ARCHITECT NOTE:**

1/2" MINIMUM DEFLECTION SPACE AT EACH FLOOR ACCOMMODATES 1/4" DISPLACEMENT. WIDER MOVEMENT JOINTS MAY BE REQUIRED BASED UPON ANTICIPATED MOVEMENTS OF STRUCTURAL ELEMENTS AND THE SEALANT PROPERTIES.

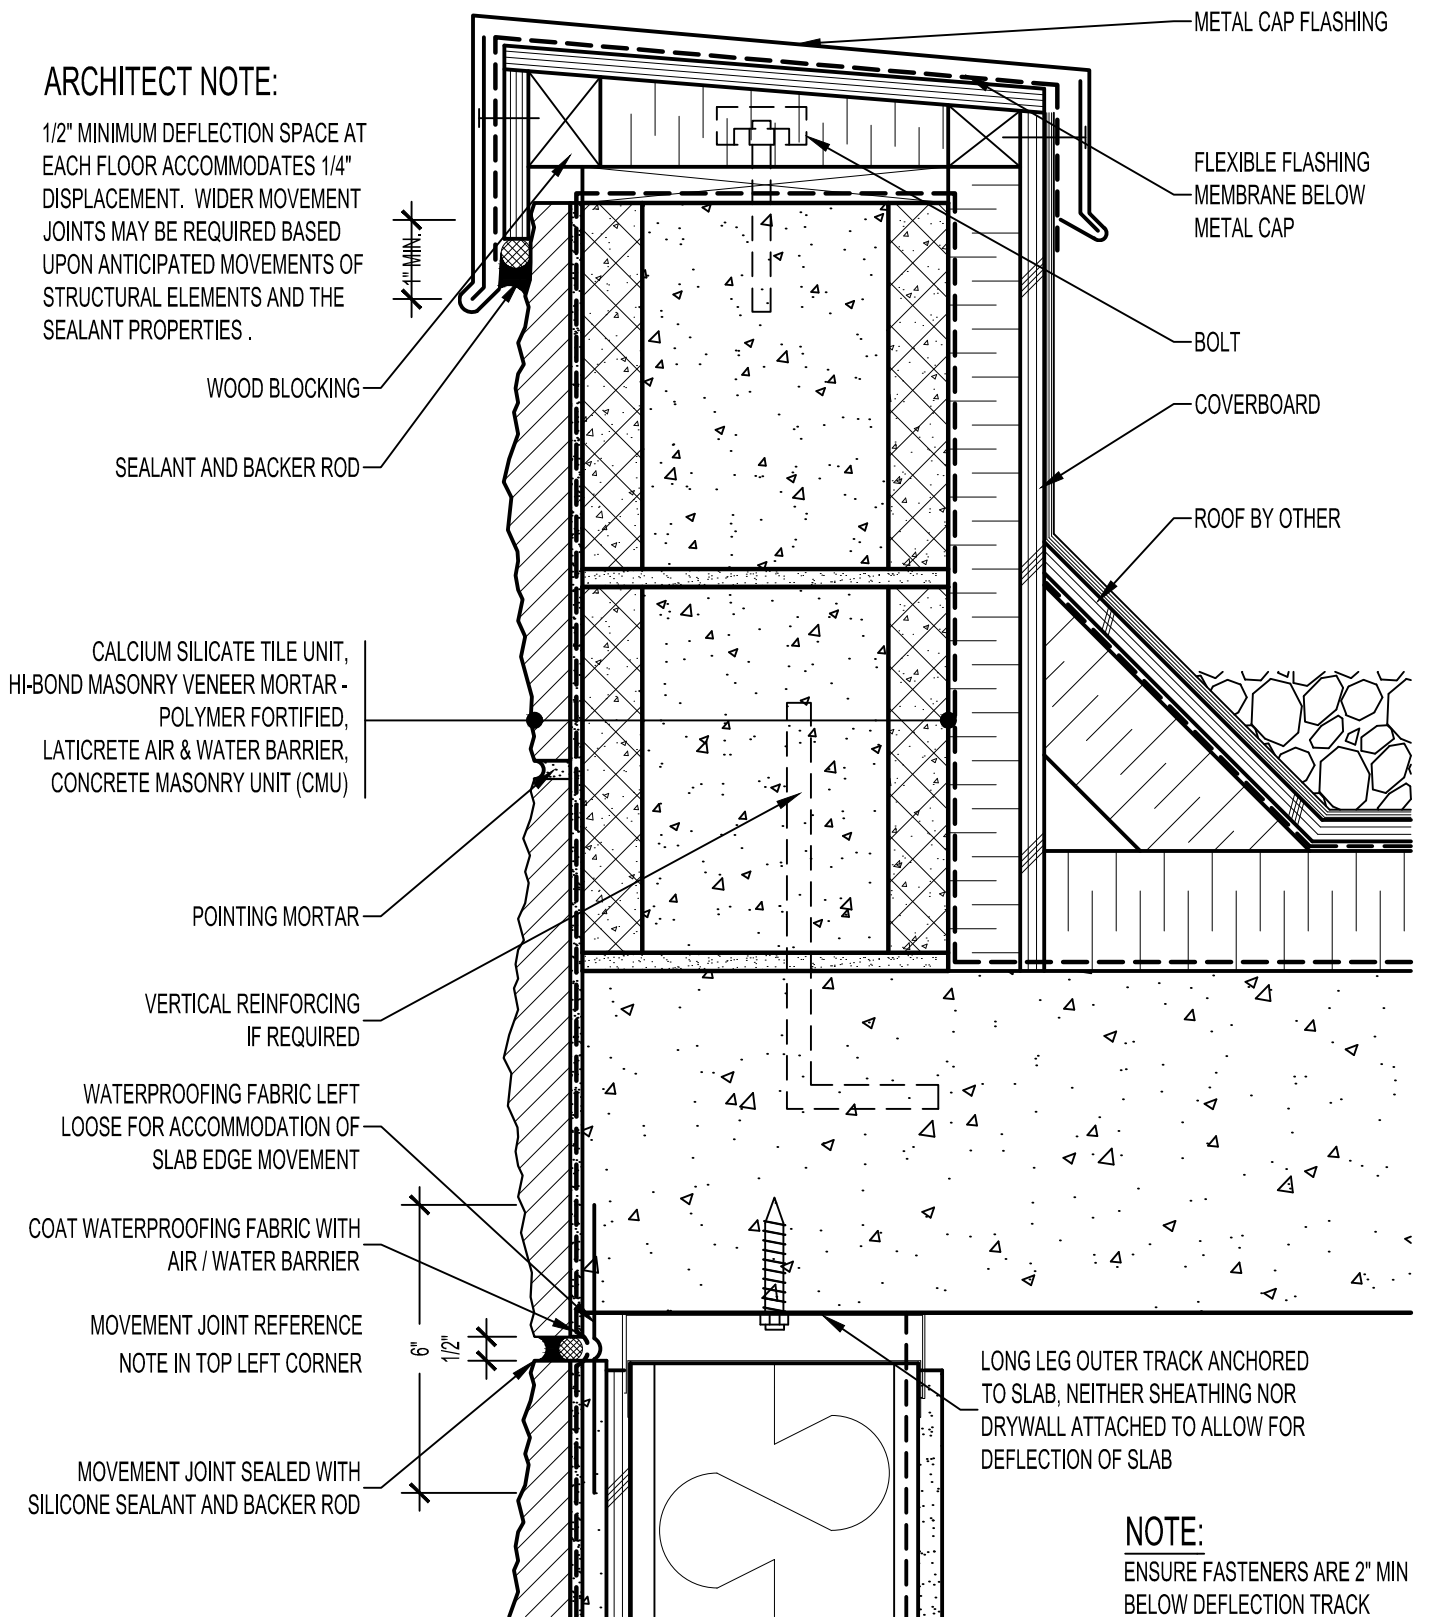

**NOTE:**  
ENSURE FASTENERS ARE 2" MIN BELOW DEFLECTION TRACK

**Arriscraft**  
Building Stone · Brick · Limestone

**ARRISCRAFT-CADD**

DETAIL No:  
SS12RAT

TITLE:  
HIGH PARAPET TO WALL  
WITH METAL CAP FLASHING

**U121**

DATE DRAWN:  
03/02/15

SCALE:  
3"=1'-0"

DRAWN BY:  
TRI