


ARCHITECT NOTE:

1/2" MINIMUM DEFLECTION SPACE AT EACH FLOOR ACCOMMODATES 1/4" DISPLACEMENT. WIDER MOVEMENT JOINTS MAY BE REQUIRED BASED UPON ANTICIPATED MOVEMENTS OF STRUCTURAL ELEMENTS AND THE SEALANT PROPERTIES.

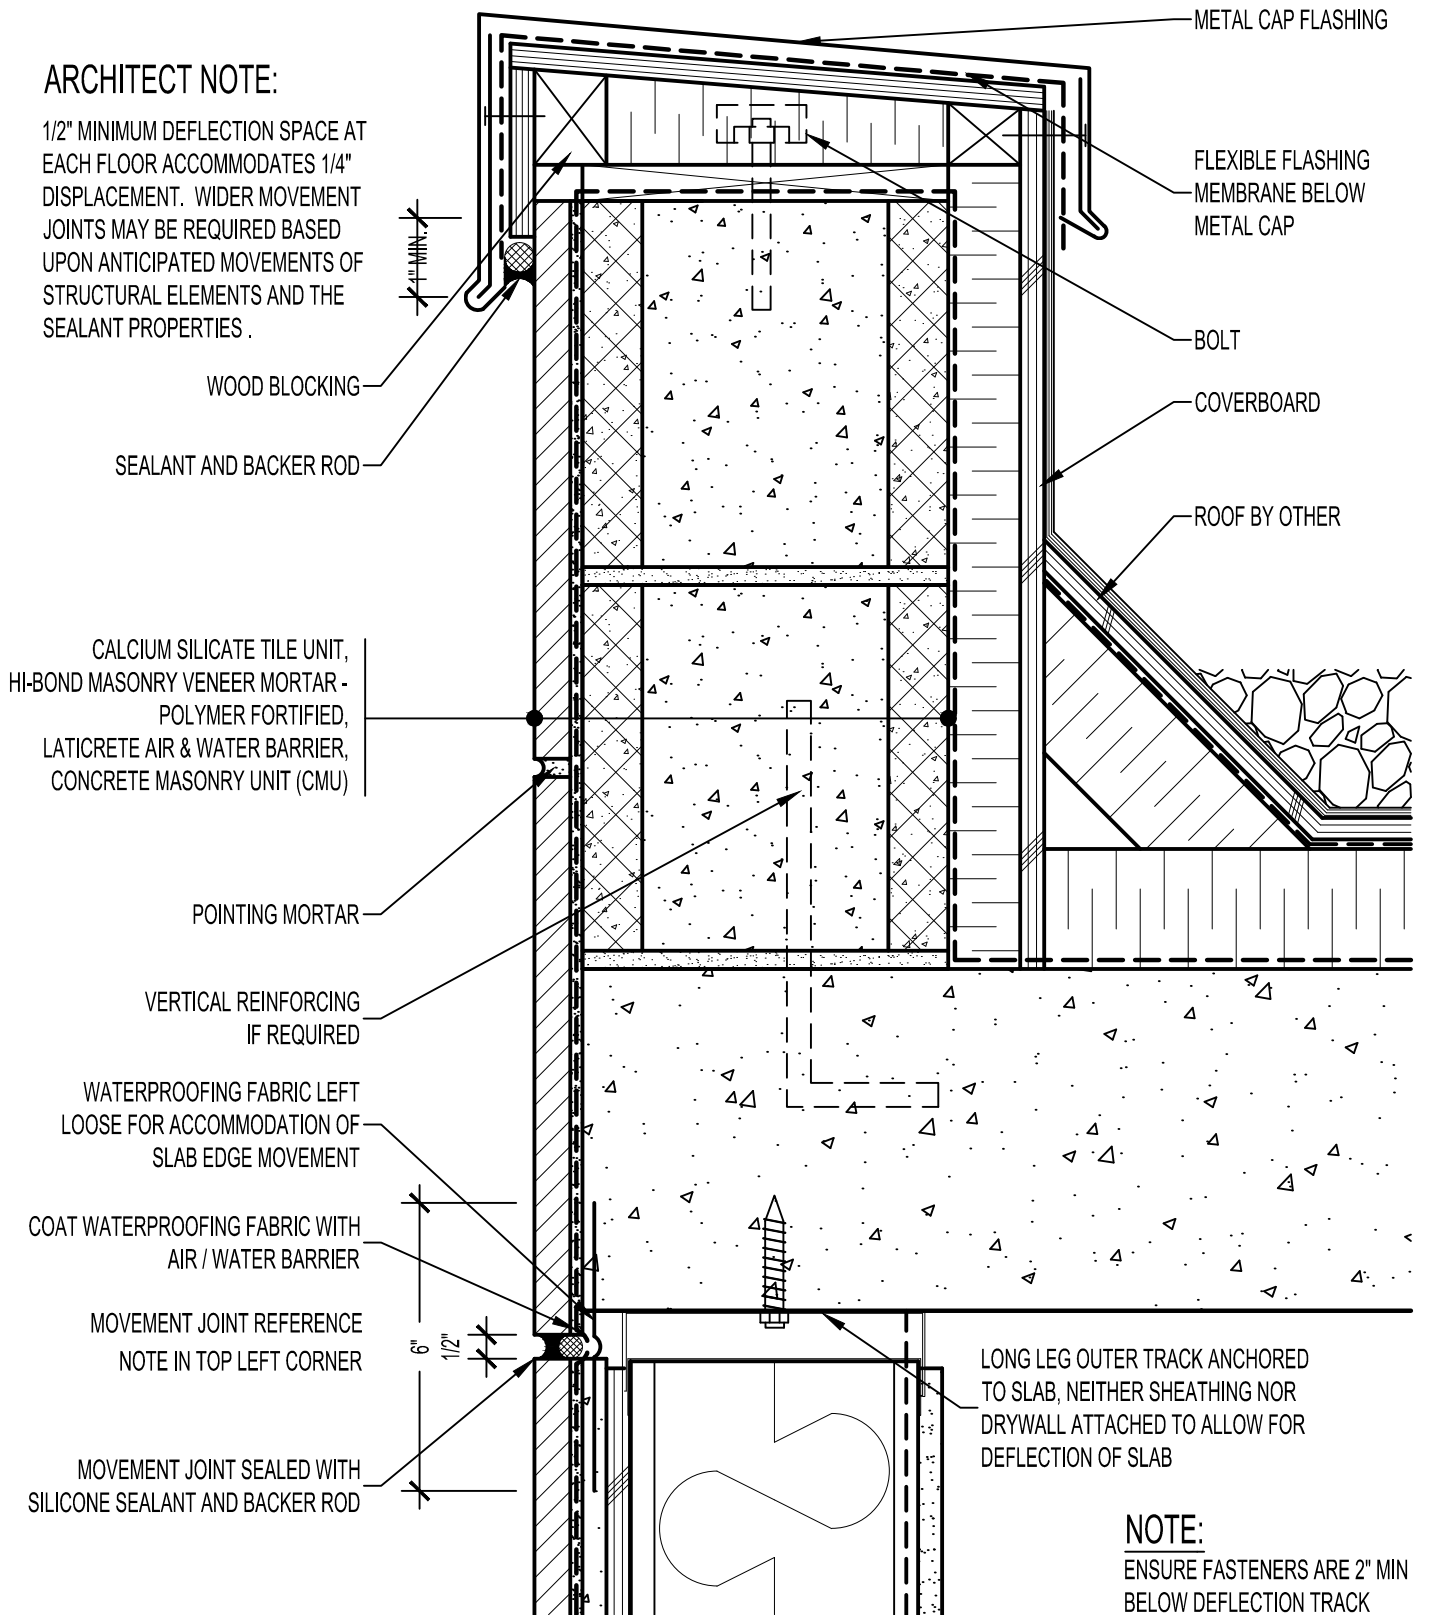

NOTE:
ENSURE FASTENERS ARE 2" MIN BELOW DEFLECTION TRACK

Arriscraft
Building Stone · Brick · Limestone

ARRISCRAFT-CADD

DETAIL No:
SS12SAT

TITLE:
HIGH PARAPET TO WALL
WITH METAL CAP FLASHING

U121

DATE DRAWN: 03/02/15	SCALE: 3"=1'-0"	DRAWN BY: TRI
-------------------------	--------------------	------------------