


**ARCHITECT NOTE:**

1/2" MINIMUM DEFLECTION SPACE AT EACH FLOOR ACCOMMODATES 1/4" DISPLACEMENT. WIDER MOVEMENT JOINTS MAY BE REQUIRED BASED UPON ANTICIPATED MOVEMENTS OF STRUCTURAL ELEMENTS AND THE SEALANT PROPERTIES.



**NOTE:**  
ENSURE FASTENERS ARE 2" MIN BELOW DEFLECTION TRACK

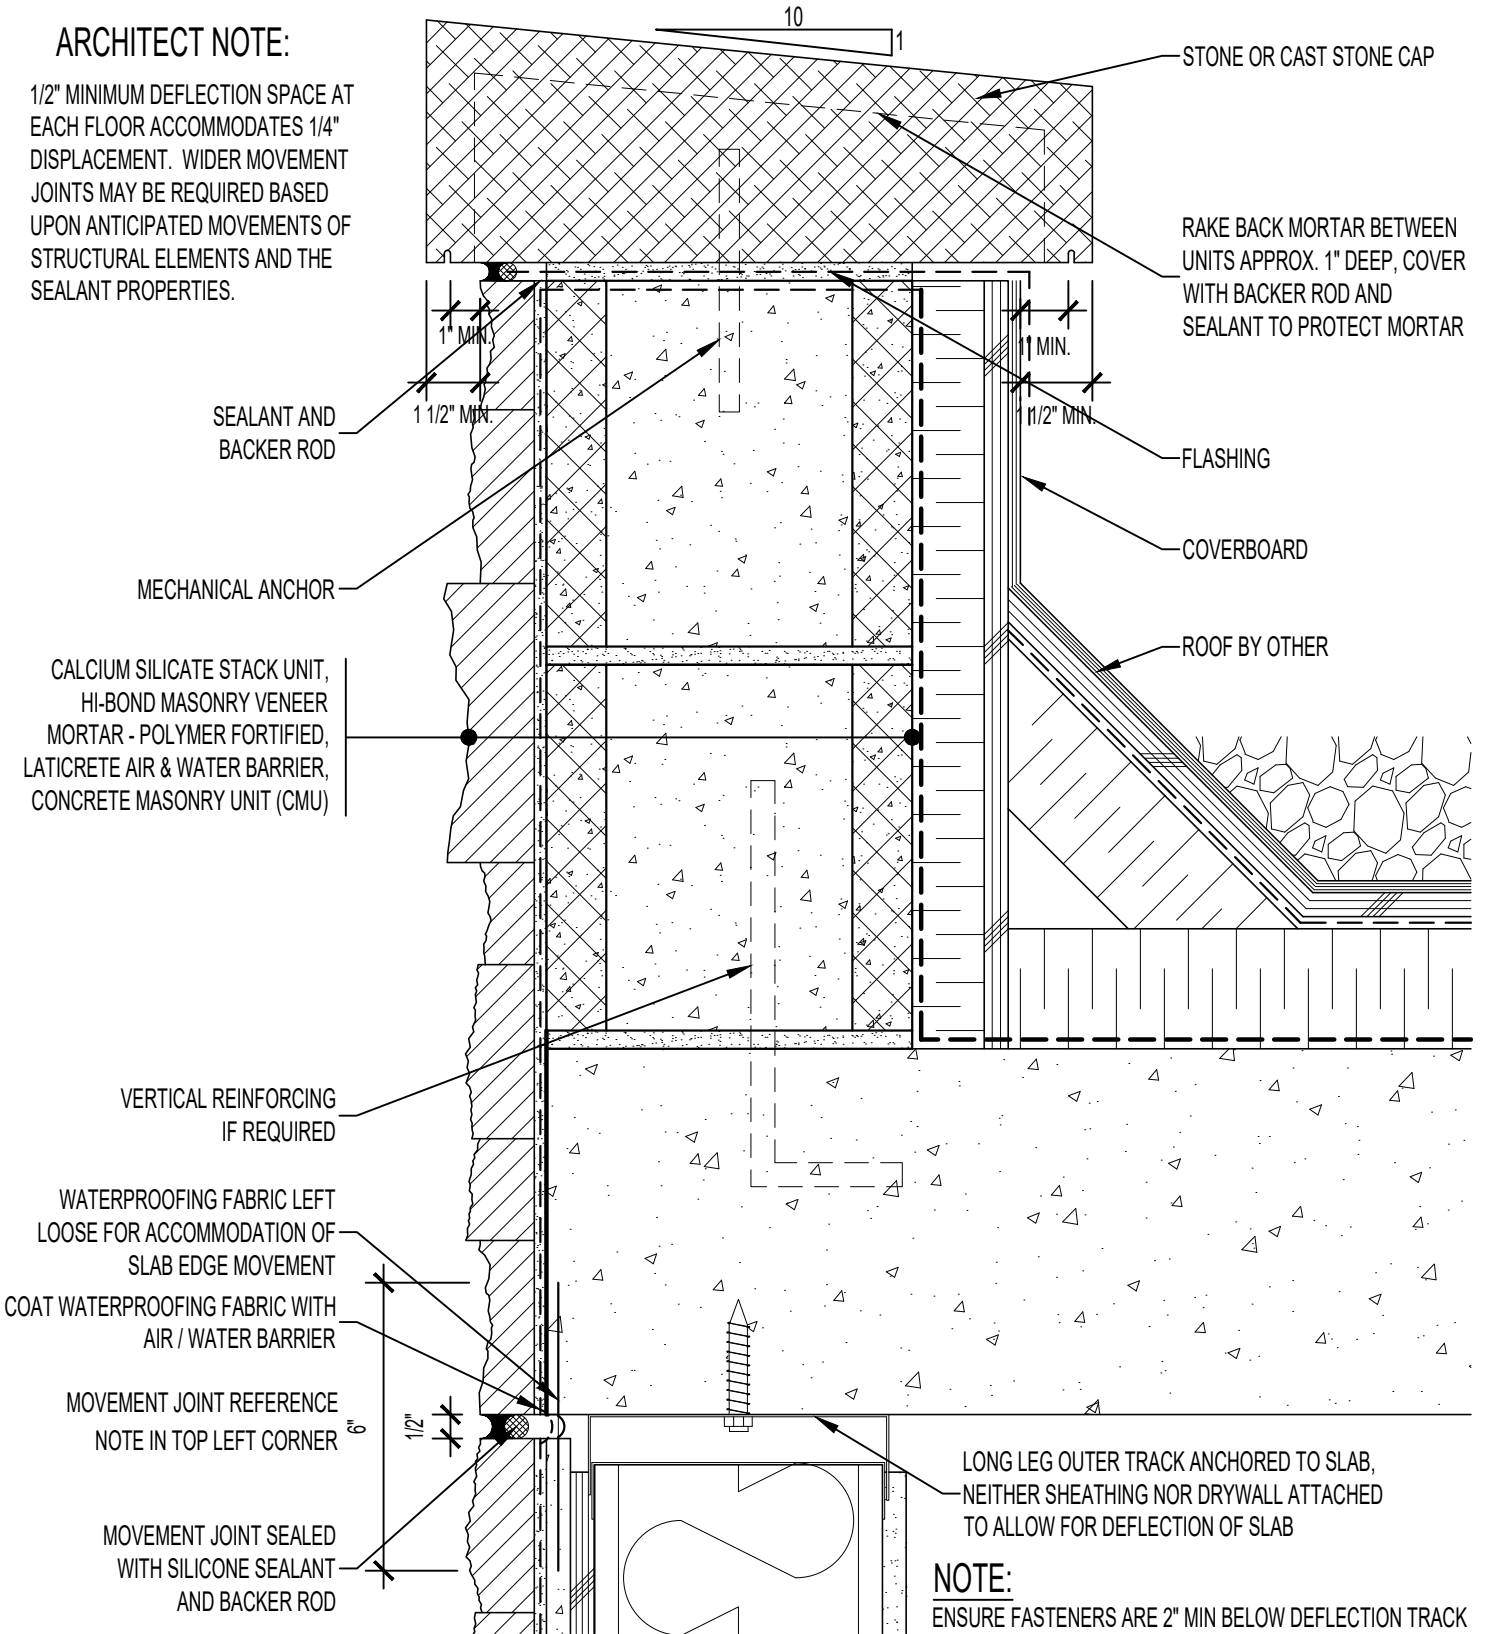

**ARRISCRAFT-CADD**

DETAIL No:

SSAS31

TITLE:

PARAPET TO WALL WITH  
STONE OR CAST STONE CAP

**U122**

DATE DRAWN:

13 Jan 2021

SCALE:

3"=1'-0"

DRAWN BY:

TRI